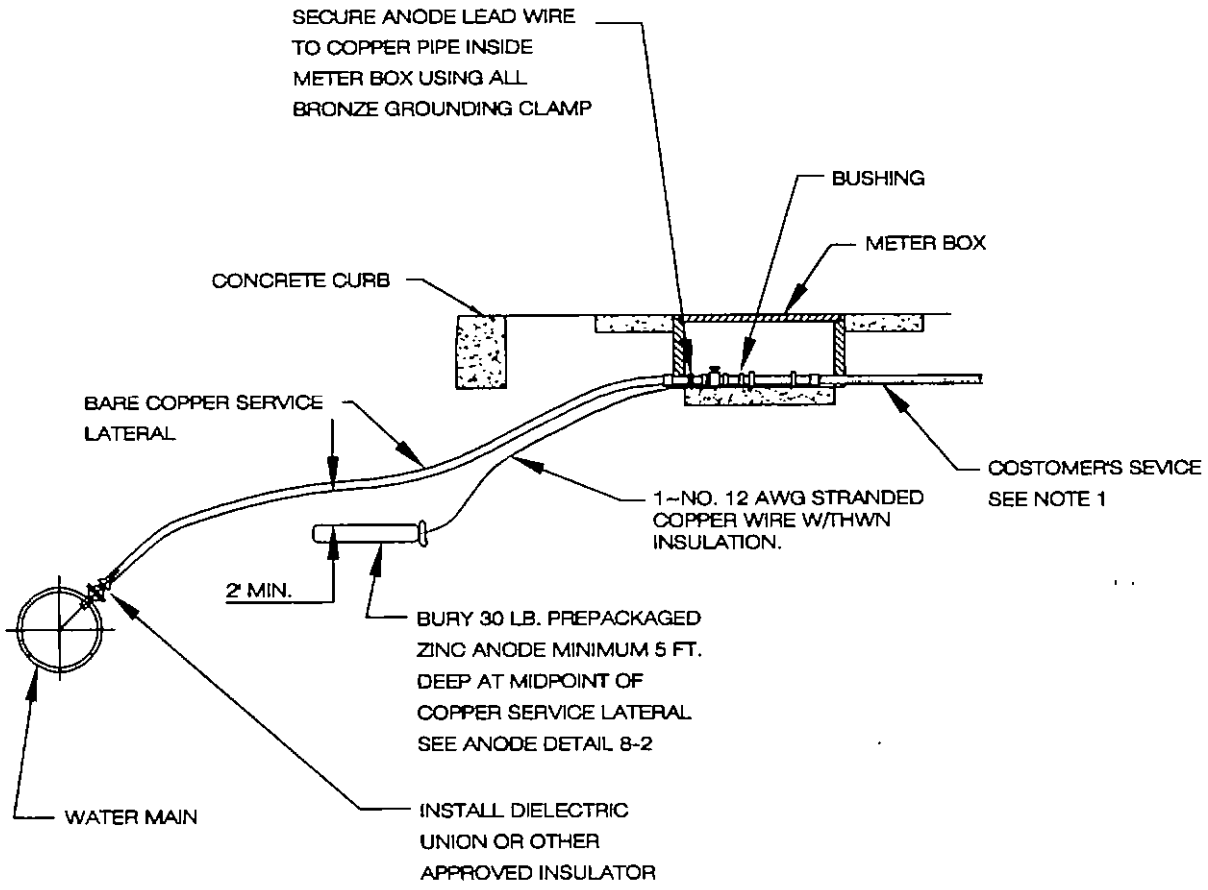

NOTES:

1. IF NONMETALLIC PIPE IS NOT INSTALLED HERE, A DIELECTRIC PIPE UNION OR OTHER APPROVED INSULATOR MUST BE INSTALLED IN THE METER BOX
2. PROVIDE A LOOP OF 18 INCHES OF SLACK WIRE INSIDE METER BOX FOR INDUCTIVELY MEASURING THE ANODE'S ELECTRICAL CURRENT OUTPUT.

REVISIONS	APPROVED	DATE	VISTA IRRIGATION DISTRICT	PATH. (TOM) H:\STDDWGS\8-14 DWG
			ZINC ANODE INSTALLATION FOR COPPER LATERALS	JOHN AMODEO R. C. E. 31161 DATE
				STANDARD DRAWING 8-14
ACAD		6/96		