



TOP VIEW

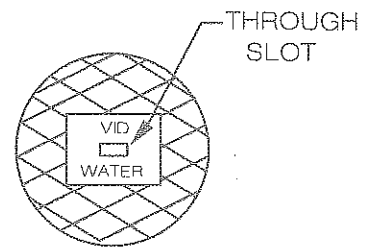

NOTES

- 1 PIPE SHALL BE SAW OR MACHINE CUT ON EACH END, NO BEVELED OR BELL SECTIONS
- 2 FOR INLINE VALVE ANCHOR BLOCK INSTALLATION SEE STD. DWG. 5-5
- 3 VALVES DEEPER THAN 5' REQUIRE A VALVE STEM EXTENSION
- 4 EXTENSION STEMS SHALL NOT BE ATTACHED / BOLTED TO OPERATING NUT
- 5 MATERIALS SHALL BE SELECTED FROM THE VID APPROVED MATERIAL LIST

ITEM NO.	SIZE AND DESCRIPTION	ITEM NO.	SIZE AND DESCRIPTION
1	RESILIENT WEDGE GATE VALVE	4	8" PVC DR-14 PIPE x REQUIRED LENGTH OF GATE WELL
2	6" HIGH x 6" WIDE COMPACTED ASPHALT-CONCRETE RING	5	SUPPORT WITH (2) 2" x 2" x 12" LONG REDWOOD BLOCKS OR THE CONCRETE VALVE BLOCKING
3	VALVE STEM EXTENSION SEE NOTES 3 & 4	6	12" x 8" GALVANIZED SLEEVE, 20 GAUGE
		7	8" x 6" GATE WELL LID SEE APPROVED VID MATERIAL LIST

REVISIONS	APPROVED	DATE	VISTA IRRIGATION DISTRICT	
UPDATED	B. SMITH	3/25/11	VALVE WELL INSTALLATION	
			 3/25/11 BRIAN SMITH DATE R.C.E. 39926	
			STD. DWG. 5-3	