




SDG&E Golden Pacific Powerlink Project

- Proposed 145-mile, 500-kilovolt transmission line
- Route alternatives cross District land
 - SDG&E requested access to conduct surveys
 - Community opposition in Warner Springs and in other areas along the preferred and alternative routes
 - Potentially significant adverse environmental impacts

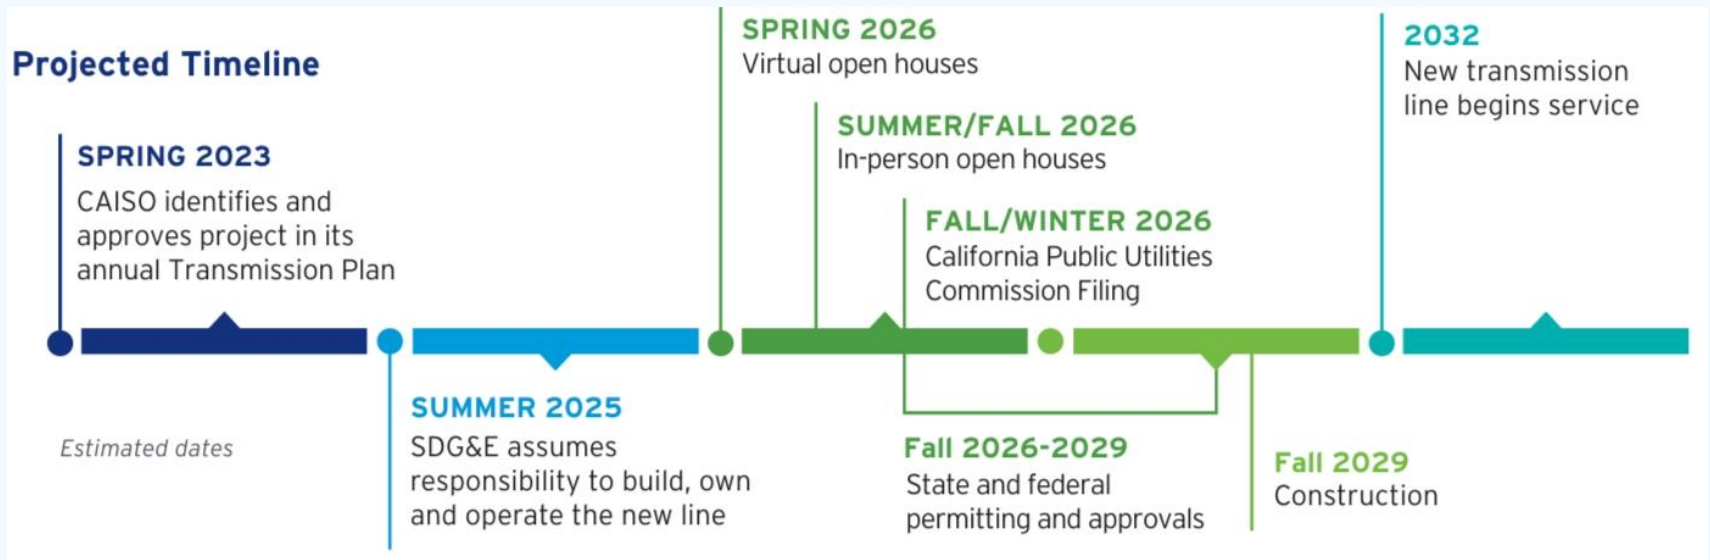

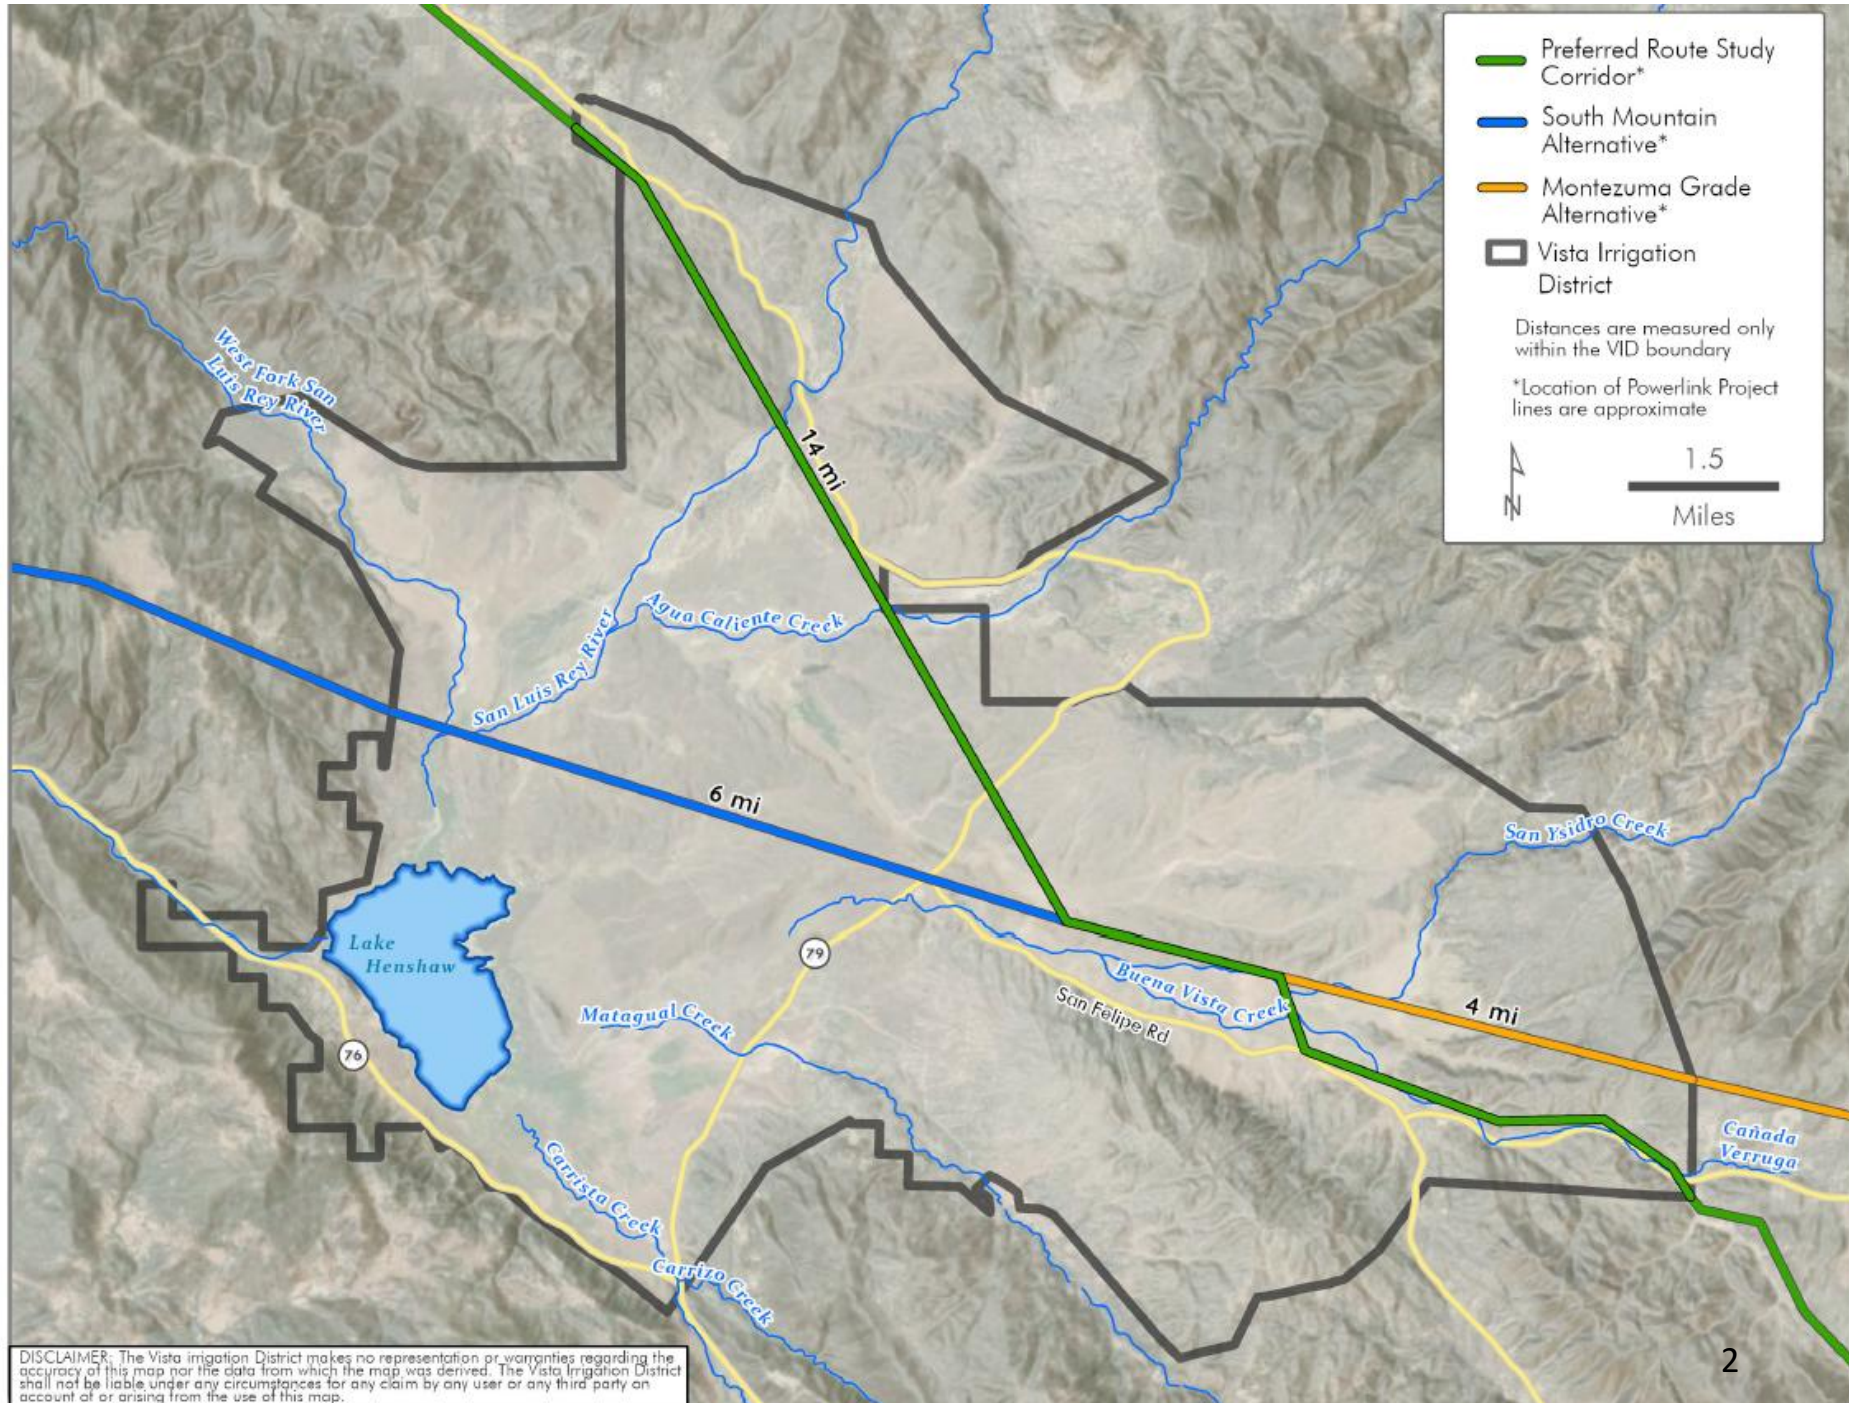

California Public Utilities Commission

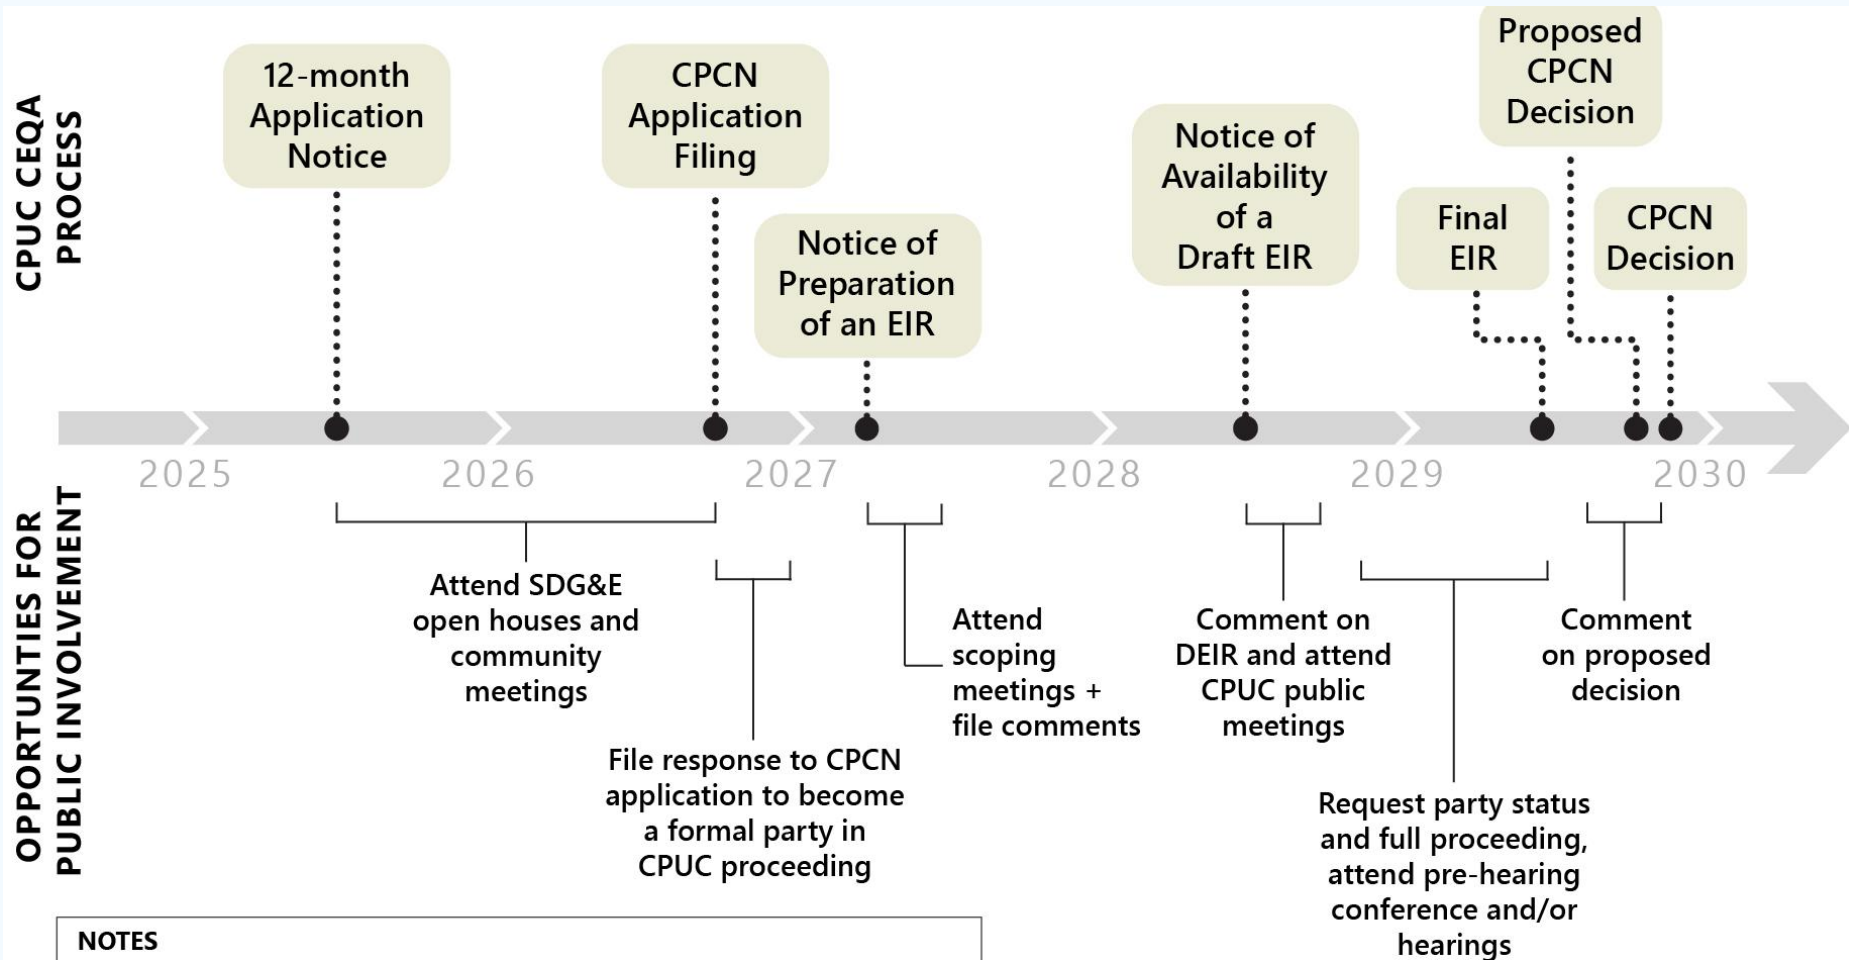

NOTES

1. This timeline represents estimated date ranges and is subject to change.
2. AB 52 Tribal Consultation will occur during initiation of the CEQA process.