






VALVE  
3-WIRE

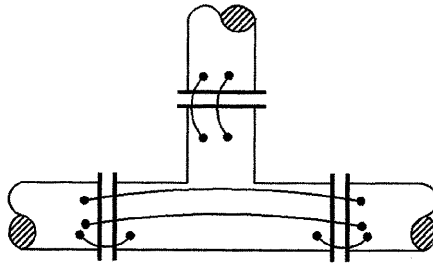

TEE  
6-WIRE




BEND  
3-WIRE

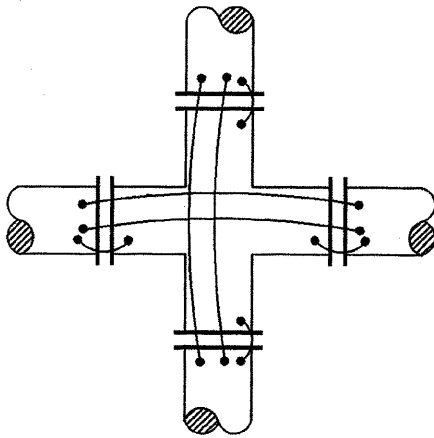

CROSS  
8-WIRE

NOTES:

1. ALL BOND WIRES SHALL BE NO. 4 AWG. STRD. COPPER WIRE W/HMPE INSULATION, INSTALLED AT MIN. LENGTH.
2. ALL WIRE CONNECTIONS SHALL BE MADE BY THE ALUMINO-THERMIC WELD PROCESS, PER DETAIL 8-15 AND ALL WIRE WELDS SHALL BE 6 INCHES APART MINIMUM.
3. THREE BOND WIRES ARE REQUIRED FOR PIPE DIAMETERS 18" AND LARGER, AND TWO BOND WIRES ARE REQUIRED FOR ALL SMALLER DIAMETERS.
4. BOND WIRES SHALL NOT BE INSTALLED ACROSS INSULATING JOINTS.

REVISIONS	APPROVED	DATE	VISTA IRRIGATION DISTRICT	PATH: (TOM) H:\STDDWGS\8-17.DWG
			<b>BONDING CONFIGURATION FOR SPECIALS</b>	 JOHN AMODEO                      DATE R. C. E. 31181
				STANDARD DRAWING 8-17
ACAD		6/96		