


VISTA IRRIGATION DISTRICT

2026 CONSUMER CONFIDENCE REPORT



Vista Irrigation District tests the drinking water quality for many constituents as required by State and Federal regulations. This report shows the results of our monitoring for the period of January 1, 2025 through December 31, 2025.

LAST YEAR, YOUR WATER MET ALL FEDERAL AND STATE SAFE DRINKING WATER STANDARDS

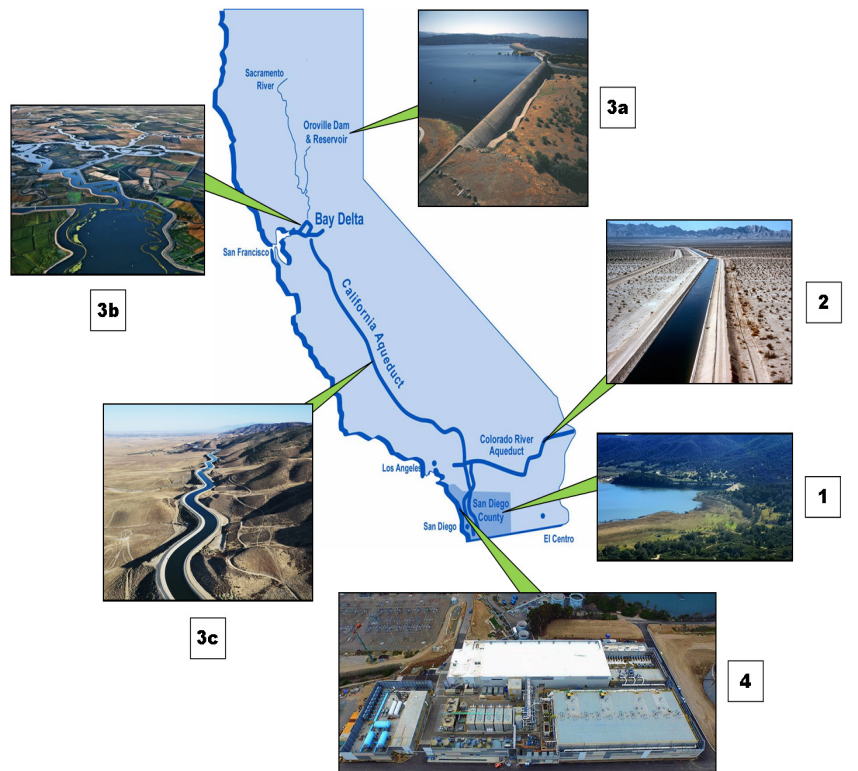

Pictured above:

California Water Infrastructure Map

1. Local Water Source - Lake Henshaw;
2. Imported Water Source - Colorado River Aqueduct;
3. Imported Water Sources: 3a. Oroville Dam & Reservoir, 3b. Bay Delta, 3c. California Aqueduct;
4. Desalinated Seawater - Carlsbad Desalination Plant

What's This Report About?

Vista Irrigation District (District) is pleased to present its annual Consumer Confidence Report (CCR), also known as the Water Quality Report. The District takes all steps necessary to safeguard your water supply, conducting more than 12,000 tests for over 75 drinking water constituents. This report provides a snapshot of the quality of water we provided last year. Included are details about where your water comes from, what it contains and how it compares to state standards. We are committed to providing you with information because informed customers are our best customers.

If you have any questions or concerns regarding the information presented in this report, please contact Dean Farris, Operations Manager, at (760) 597-3143. This report is available on our website at www.vidwater.org.

Where Does My Water Come From?

Vista Irrigation District (District) uses four sources for your drinking water. The first one is local water, which originates from the watershed and well fields located near Lake Henshaw. The District owns the 43,000-acre Warner Ranch which encompasses the lake and monitors activities that could contaminate it. Water from Lake Henshaw is transferred to Lake Wohlford via a canal originally constructed in the 1890s. Once the water reaches the Escondido-Vista Water Treatment Plant (EVWTP), it is treated and disinfected to protect you against microbial contaminants. The second water source is the Colorado River. The third source is from Northern California. The latter two, called imported water, are delivered to San Diego County and ultimately to the District via the Metropolitan Water District of Southern California (MWD) and the San Diego County Water Authority (Water Authority). Imported water may be treated at EVWTP, Water Authority's Twin Oaks Valley Water Treatment Plant in San Marcos, Oceanside's Robert A. Weese Filtration Plant, or MWD's Skinner Treatment Plant in Riverside County. The fourth source is desalinated seawater from the Claude "Bud" Lewis Carlsbad Desalination Plant. The District's Public Water System ID is CA3710027.

Esté informe contiene información muy importante sobre su agua potable. Comuníquese con Vista Irrigation District para obtener una copia de éste reportaje en Español. Llame al (760) 597-3100.

What Were the Findings of the Local and Imported Source Water Assessments?

Local Water Sources

In December 2021, Vista Irrigation District (District), in conjunction with the City of Escondido, prepared a sanitary survey of the local watershed. This survey assesses activities within the watershed that have the potential to influence the quality of water delivered from Lake Henshaw, Dixon Lake and Lake Wohlford. While the survey identifies a number of activities that have the potential to adversely affect water quality, including residential septic facilities, highway run-off, and agricultural and recreational activities, no contaminants from these activities were detected in the local water supply in 2021. A copy of the Watershed Sanitary Survey, which contains a Source Water Assessment Program, is available for review at the District office located at 1391 Engineer Street in Vista.

Imported Water Sources

The Metropolitan Water District of Southern California (MWD) completed its source water assessment of its Colorado River and California State Water Project supplies in December 2002. Colorado River supplies are considered to be most vulnerable to contamination from recreation, urban/storm water runoff, increasing urbanization in the watershed and wastewater. State Water Project supplies are considered most vulnerable to contamination from urban/storm water runoff, wildlife, agriculture, recreation and wastewater.

MWD updates its source water assessment through watershed sanitary surveys every five years. The most recent watershed sanitary surveys of its source water supplies from the Colorado River was updated in 2022 and the State Water Project was updated in 2021. Watershed sanitary surveys examine potential sources of contamination, summarize and evaluate water quality data and compliance with regulations, and recommend actions to better protect and improve source water quality.



Why Is There Anything In My Water?

The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally-occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activity.

The following contaminants may potentially be present in our water sources:

- Microbial contaminants, such as viruses and bacteria, that may come from sewage treatment plants, septic systems, agricultural livestock operations, and wildlife.
- Inorganic contaminants, such as salts and metals, that can be naturally-occurring or result from urban stormwater runoff, industrial or domestic wastewater discharges, oil and gas production, mining, or farming.
- Pesticides and herbicides, which may come from a variety of sources such as agriculture, urban stormwater runoff, and residential uses.
- Organic chemical contaminants, including synthetic and volatile organic chemicals, that are by-products of industrial processes and petroleum production, and can also come from gas stations, urban stormwater runoff, agricultural application and septic systems.
- Radioactive contaminants, which can be naturally-occurring or be the result of oil and gas production and mining activities.

Do I Need To Take Precautions?

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that the water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the U.S. Environmental Protection Agency's (USEPA) Safe Drinking Water Hotline at 1-800-426-4791.

Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons, such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. USEPA/Centers for Disease Control (CDC) guidelines on appropriate means to lessen the risk of infection by *Cryptosporidium* and other microbial contaminants are available by calling the Safe Drinking Water Hotline at 1-800-426-4791.

Keeping You INFORMED

What Are PFAS?

Recent news about the presence of PFAS chemicals in drinking water may raise concerns about whether your drinking water is at risk. Perfluorooctanoic acid (PFOA) and perfluorooctane sulfonic acid (PFOS) are fluorinated organic chemicals that are part of a larger group of synthetic chemicals referred to as per- and polyfluoroalkyl substances (PFAS). Vista Irrigation District tested your water supply for PFOA and PFOS as required by the United States Environmental Protection Agency (EPA) and no PFAS were detected.

PFAS are synthetic compounds used extensively in consumer products such as carpets, clothing, fabrics for furniture, paper packaging for food, make-up, fire-fighting foams, and other materials (e.g., cookware) designed to be waterproof, stain-resistant or non-stick. Two of the most well-known chemicals, PFOS and PFOA, have been phased out in the United States, but do not break down easily and can linger in the environment.

Water is just one of many ways that people come in contact with these substances. People can become exposed to PFAS in a

variety of ways, including through consumer products that contain the chemicals, food exposed to the chemicals, and drinking water that has been impacted by the chemicals. The presence of PFAS in drinking water is complex and often due to widespread use and environmental persistence. PFAS are resistant to heat, water and oil and have been used for decades in hundreds of industrial applications and consumer products. PFAS have been found both in the environment and in blood samples of the general U.S. population. The U.S. Food and Drug Administration has also detected PFAS chemicals in the U.S. food supply.

Vista Irrigation District takes any risks to your water quality seriously and continues to take all steps necessary to safeguard your water supply. To learn more about Vista Irrigation District drinking water quality, visit www.vidwater.org/water-quality. You may also contact our water quality staff at (760) 597-3143 with any questions.

You can learn more about PFAS from the EPA and California Division of Drinking Water at <http://www.epa.gov/pfas> and <https://www.waterboards.ca.gov/pfas/>.

In order to ensure that tap water is safe to drink, the U.S. Environmental Protection Agency (USEPA) and the State Department of Public Health (DPH) prescribe regulations that limit the amount of certain contaminants in water provided by public water systems. DPH regulations also establish limits for contaminants in bottled water that must provide the same protection for public health.

VID HAS NOT HAD ANY VIOLATIONS OF THESE REGULATIONS!

WHAT ARE THESE TABLES?

The data tables shown on this page and the following page list all of the drinking water constituents that were detected during the most recent sampling for the constituent. The presence of these constituents in the water does not necessarily indicate that the water poses a health risk. The State Water Resources Control Board (SWRCB) requires Vista Irrigation District to monitor for certain constituents less than once per year because the concentrations are not expected to vary significantly from year to year. Some of the data, though representative of the water quality, are more than one year old. The terms used in these data tables can be found listed at the bottom of the table on the following pages.

Some of the following tables show water from two sources - local water from Lake Henshaw, which is treated at the Escondido-Vista Water Treatment Plant (EVWTP) and imported water, which is treated at the San Diego County Water Authority’s Twin Oaks Valley Water Treatment Plant, Metropolitan Water District of Southern California’s Skinner Treatment Plant, Robert A. Weese Filtration Plant, and at the EVWTP.

2025 WATER QUALITY MONITORING RESULTS											
Parameter	Units	State MCL [MRDL]	PHG (MCLG) [MRDLG]	Range ----- Average	Treatment Plant Effluents					DLR	Typical Source/ Comments
					Escondido-Vista Water Treatment Plant	Twin Oaks Valley Water Treatment Plant	Skinner Treatment Plant	Weese Filtration Plant	Carlsbad Desalination Plant		
Primary Standards											
Clarity (Turbidity)											
Combined Filter Effluent Turbidity*	NTU	TT=1	NA	Range	0.02 - 0.09	0.01 - 0.10	NR - NR	NR - NR	NR - NR	NA	Soil Runoff
				Average	0.05	0.02	NR	NR	NR		
				Highest	0.09	0.10	0.07	0.62	0.06		
	% < 0.3 NTU	95%	NA	Percentage	100%	100%	100%	98%	100%	NA	Soil Runoff
* Turbidity is a measurement of the cloudiness of water and is a good indicator of water quality and filtration performance. Turbidity results, which meet performance standards, are considered to be in compliance with filtration requirements.											
Inorganic Constituents											
Aluminum (Al)	ug/L	1000	600	Range	ND - 60	ND - 0.07	ND - 120	ND - 0.09	ND - ND	50	Residue from water treatment process; natural deposits; erosion
				Average	ND	ND	57	0.03	ND		
Barium (Ba)	mg/L	1	2	Range	NR - NR	ND - 105	NR - NR	NA - NA	ND - ND	0.1	Discharges of oil drilling wastes and from metal refineries; erosion of natural deposits
				Average	NR	ND	NR	0.12	ND		
Chromium, Hexavalent (Cr6+)	ug/L	10	0.02	Range	NR - NR	ND - 0.37	ND - ND	NR - NR	ND - ND	0.01	Runoff/leaching frpm natural deposits; discharge from industrial wastes
				Average	NR	0.24	ND	NR	ND		
Fluoride (F-) Treatment Related	mg/L	2.0	1.0	Range	0.54 - 0.73	0.2 - 0.70	0.60 - 0.80	0.18 - 0.26	0.57 - 0.87	0.1	Erosion of natural deposits; water additive for dental health
				Average	0.64	0.60	0.70	0.22	0.69		
Nitrate (NO₃)	mg/L	10	10	Range	NR - NR	ND - 0.50	ND - ND	ND - 0.91	ND - ND	0.4	Runoff/leaching from fertilizer use; sewage; natural erosion
				Average	NR	ND	ND	0.40	ND		
Radionuclides Analyzed Every Four Years for Four Consecutive Quarters											
Gross Alpha Activity	pCi/L	15	(0)	Range	ND - 4.8	NA - NA	ND - 4.0	3.1 - 3.1	ND - ND	3.0	Erosion of natural deposits
				Average	3.30	ND	ND	3.1	ND		
Gross Beta Activity	pCi/L	50*	(0)	Range	5.5 - 22.1	NA - NA	ND - 5.0	NA - NA	ND - ND	4.0	Decay of natural and man-made deposits
				Average	13.6	4.23	ND	NA	ND		
* If measured gross beta activity, excluding naturally occurring potassium-40, is less than or equal to 50 pCi/L, it is considered to be in compliance with the state's MCL dose limit of 4 millirem/year for radionuclides in drinking water.											
Uranium (U) Beta	pCi/L	20	0.43	Range	NR - NR	1.7 - 2.8	ND - 3.0	NR - NR	ND - ND	1.0	Erosion of natural deposits
				Average	NR	2.3	2.0	2.5	ND		
Disinfectants and Disinfection Byproducts in Treatment Plant Effluent											
Effluent Total Chlorine Residual	mg/L	[4]	[4]	Range	NR - NR	2.0 - 3.9	1.1 - 3.1	NR - NR	2.81 - 3.48	-	Addition of chlorine and ammonia as combined disinfectant chloramines.
				Average	NR	3.0	2.6	NR	3.17		
Effluent Total Trihalomethanes	ug/L	80	NS	Range	20 - 40	26 - 46	13 - 46	NR - NR	ND - ND	1	By-products of drinking water chlorination
				Average	33	NR	30	NR	ND		
Effluent Haloacetic Acids (HAA5)	ug/L	60	NS	Range	6.8 - 13	4 - 19.2	1.4 - 18	NR - NR	ND - ND	1	By-products of drinking water chlorination
				Average	10	NR	9.4	NR	ND		
Bromate	ug/L	10	0.1	Range	NR - NR	ND - 13.0	ND - 8.3	NA - NA	NA - NA	1	By-products of driking water ozonation
				Average	NR	NR	1.8	NA	NA		
Chlorite (ClO2-)	mg/L	1.0	0.05	Range	0.17 - 0.60	NR - NR	NR - NR	NR - NR	NR - NR	0.02	By-products of drinking water chlorination
				Average	0.35	NR	NR	NR	NR		
Disinfectants and Disinfection Byproducts in VID Distribution System											
Total Chlorine Residual	mg/L	[4]	[4]	Range	0.30 - 3.98					NS	Addition of chlorine and ammonia as combined disinfectant chloramines.
				Average	2.53						
Total Trihalomethanes (TTHM)	ug/L	80	NS	Range	14.4 - 60.2					NS	By-products of drinking water chlorination
				Highest LRAA	45.8						
Haloacetic Acids (HAA5)	ug/L	60	NS	Range	4.1 - 31.8					NS	By-products of drinking water chlorination
				Highest LRAA	19.9						
Microbiological Constituents in VID Distribution System											
Total Coliform Bacteria (monthly positives)	%	5	(0)	Range	0% - 0.65%					-	Naturally present in the environment
				Monthly Highest	0.65%						
Fecal Coliform/ E.Coli	%	*	(0)	Range	0% - 0%					-	Naturally present in the environment
				Average	0%						
* Fecal Coliform/E.Coli MCLs: The occurrence of two consecutive total coliform positive samples, one of which contains fecal coliform/E.Coli, constitutes an acute MCL violation. The MCL was not violated during this reporting period.											
Secondary Standards (Aesthetic Standards)											
Color	units	15	NS	Range	1 - 1	ND - 1	1 - 1	NR - NR	ND - ND	-	Decaying vegetation or other naturally occurring organic materials
				Average	1	ND	1	NR	ND		
Chloride (Cl-)	mg/L	500	NS	Range	82 - 97	NR - NR	87 - 91	83 - 114	59 - 110	-	Runoff/leaching from natural deposits; seawater influence
				Average	91	NR	89	94	85		
Sulfate (SO₄)²⁻	mg/L	500	NS	Range	160 - 190	100 - 160	164 - 171	106 - 230	12 - 15	0.5	Runoff/leaching from natural deposits; industrial wastes
				Average	173	146	168	171	13.5		
Total Dissolved Solids	mg/L	1000	NS	Range	463 - 631	250 - 490	501 - 513	NR- NR	105 - 310	-	Runoff/leaching from natural deposits; industrial wastes
				Average	527	337	507	574	239		
Specific Conductance	umho/cm	1600	NS	Range	788 - 994	NA - NA	824 - 847	656 - 964	235 - 531	-	Substances that form ions in water; seawater influence
				Average	853	840	836	820	443		
Additional Analyzed											
Total Organic Carbon (TOC)	mg/L	TT	NS	Range	1.4 - 4.0	1.8 - 2.3	2.0 - 2.8	NR - NR	NA - NA	0.3	Naturally occurring organic material
				Average	2.3	2.1	2.6	NR	NA		
Alkalinity, Total	mg/L	NS	NS	Range	99 - 140	NA - NA	105 - 108	96.7 - 128	46 - 83	-	Erosion of natural deposits; leaching
				Average	115	120	106	112	62		
Bicarbonate (HCO3)	mg/L	NS	NS	Range	121 - 171	NR - NR	NR - NR	NR - NR	NR - NR	-	Erosion of natural deposits; leaching
				Average	140	NR	NR	NR	NR		

2025 WATER QUALITY MONITORING RESULTS (continued)

Parameter	Units	State MCL	PHG (MCLG) [MRDLG]	Range	Treatment Plant Effluents					DLR	Typical Source/Comments
				Average	Escondido-Vista Water Treatment Plant	Twin Oaks Valley Water Treatment Plant	Skinner Treatment Plant	Weese Filtration Plant	Carlsbad Desalination Plant		
Additional Analyzed cont'd											
Hardness as CaCO3	mg/L	NS	NS	Range	210 - 230	NR - NR	228 - 232	160 - 310	54 - 69	-	Erosion of natural deposits; leaching
				Average	215	NR	230	226	61		
Calcium (Ca)	mg/L	NS	NS	Range	50 - 58	NR - NR	54 - 55	37 - 81	17 - 69	-	Erosion of natural deposits; leaching
				Average	52	NR	54	57	24		
Magnesium (Mg)	mg/L	NS	NS	Range	19 - 21	NR - NR	21 - 21	17 - 25	1.2 - 1.7	-	Erosion of natural deposits; leaching
				Average	20	NR	21	20	1.4		
Sodium (Na)	mg/L	NS	NS	Range	82 - 94	NR - NR	83 - 87	NR - NR	48 - 62	-	Erosion of natural deposits; leaching
				Average	88	NR	85	86	57		
pH	units	NA	NS	Range	7.9 - 8.2	7.4 - 9.0	8.2 - 8.2	8.0 - 8.5	8.3 - 8.6	-	Measurement of acidity/alkalinity
				Average	8.1	8.5	8.2	8.2	8.5		
Potassium (K)	mg/L	NS	NS	Range	4.2 - 5.4	NR - NR	4.2 - 4.4	NR - NR	ND - 49.5	-	Erosion of natural deposits; leaching
				Average	4.8	NR	4.3	NR	31.2		
Chlorate	ug/L	NL=800	NS	Range	220 - 490	NR - NR	ND - ND	NR - NR	NR - NR	20	By-product of drinking water chlorination
				Average	380	NR	ND	NR	NR		
Silica (SiO2)	mg/L	NS	NS	Range	7.6 - 10.0	NR - NR	NR - NR	NR - NR	NR - NR	-	Erosion of natural deposits; leaching
				Average	8.4	NR	NR	NR	NR		
Boron (B)	mg/L	NL=1	NS	Range	0.11 - 0.13	NR - NR	NR - NR	NA - NA	0.51 - 0.92	0.1	Runoff/leaching from natural deposits; industrial wastes
				Average	0.12	NR	NR	NA	0.69		
Unregulated Contaminates (PFAS)											
Perfluorobutanoic acid (PFBA)	ng/L	NS	NS	Range	ND - 6.0	ND - ND	ND - ND	NR - NR	NR - NR		A breakdown product of manmade PFAS used in consumer products and industrial application; Used for manufacturing photographic film.
				Average	ND	ND	ND	NR	NR		
Parameter	Units	Action Level	PHG (MCLG)	VID Service Area Number of Samples		VID Service Area 90th Percentile		VID Service Area Action Levels Exceeded		DLR	Typical Source/Comments
Inorganic Constituents - Copper/Lead in Residential Taps (Sampled in 2024)											
Copper (Cu)	mg/L	1.3	0.3	51		0.54		0		0.05	Corrosion of household plumbing systems; erosion of natural deposits
Lead (Pb)	ug/L	15	0.2	51		4.2		0		5	Internal corrosion of household water plumbing systems; discharges from industrial manufacturers; erosion of natural deposits

TERMS USED IN THIS REPORT

Detection Limit for Reporting (DLR): A detected contaminant is any contaminant detected at or above its detection level for purposes of reporting.

Locational Running Annual Average (LRAA): The average of sample analytical results for samples taken at a particular monitoring location during the previous four calendar quarters.

Maximum Residual Disinfectant Level (MRDL): The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

Maximum Residual Disinfectant Level Goal (MRDLG): The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.

Primary Drinking Water Standards (PDWS): MCLs for contaminants that affect health along with their monitoring and reporting requirements, and water treatment requirements.

Public Health Goal (PHG): The level of a contaminant in drinking water below which there is no known or expected risk to health. PHGs, set by the California Environmental Protection Agency, are not regulatory standards, not enforceable and are not required to be met by public water systems.

mg/L: Milligrams per liter or parts per million (ppm) = 1 drop in 10 gallon aquarium

ug/L: Micrograms per liter or parts per billion (ppb) = 1 drop in residential size pool

pCi/L: Picocuries per liter (a measure of radiation)

umho/cm: Micromho per centimeter; measurement of conductivity

NA: Not Applicable

NC: Not Collected

Maximum Contaminant Level (MCL): The highest level of a contaminant that is allowed in drinking water. Primary MCLs are set as close to the PHGs (or MCLGs) as is economically and technologically feasible. Secondary MCLs are set to protect the odor, taste and appearance of drinking water.

Maximum Contaminant Level Goal (MCLG): The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are set by the U.S. Environmental Protection Agency.

Millirem: A unit of measure for radiation dose, commonly used to quantify radiation exposure from medical x-rays and background radiation.

Nephelometric Turbidity Units (NTU): Turbidity is a measure of the cloudiness of the water. It is a good indicator of the effectiveness of the water treatment process and distribution system.

Regulatory Action Level (AL) / Notification Level (NL): The concentration of a contaminant which, if exceeded, triggers treatment or other requirements which a water system must follow.

Treatment Technique (TT): A required process intended to reduce the level of a contaminant in drinking water.

ND: Not Detectable at testing limit
NR: Not Reported
NS: No Standard
>: More than
<: Less than
≤: Less than or equal to

Frequently Asked Questions

Q. What affects the taste of my water?

A. The taste of drinking water is affected by its mineral content as well as the presence of chlorine, which is used to protect against potential bacterial contamination. Sometimes plumbing can cause a metallic flavor, especially if the water has been sitting in pipes for many hours. Taste, however, does not indicate a higher or lower degree of water quality.

Q. What causes bad odors?

A. Musty or fishy odors can be caused by harmless algae in the water, especially during the hot summer months. Even after chlorine has been added to disinfect the water, these odors may persist. Also, many people mistakenly confuse odors from their sink drain with the smell of their tap water. Check for tap water odors by filling a glass with fresh tap water and smelling it away from the sink.

Q. What causes hardness in water?

A. A water's "hardness" is a measure of the amount of certain minerals that are dissolved in the water. Depending on varying sources and system flows, the hardness of Vista Irrigation District water ranged from 54 - 310 mg/L in 2025. These values translate to 3.2 - 18.1 grains per gallon. These numbers may be of interest because some household appliances (such as dishwashers or water treatment devices) have settings that need to be adjusted based on the hardness of the water.

The minerals in water may leave white spots on glasses, coffeepots, shower heads or shower doors. These spots are mainly calcium deposits and are not harmful to health. Putting vinegar in a coffeepot and allowing it to sit overnight will usually remove the spots. Make sure to rinse well before using. There are also some store products you can use to avoid spotting when glasses are washed and allowed to dry.

Q. What causes cloudy water?

A. Cloudy or milky-looking water is usually caused by trapped air picked up from an air pocket in the water main or internal plumbing. Unusual surges or flows within the aqueduct can also trap air, similar to a waterfall. If the water is allowed to sit in a glass or pitcher for a few minutes, the air will dissipate and the water will become clear.

Q. What is Geosmin?

A. Geosmin is a non-harmful, naturally occurring compound produced by bacteria in soil and algae found in surface water. Geosmin is common throughout the United States; in southern California, it is most noticeable during warmer months and when Vista Irrigation District's water supply is sourced from open surface reservoirs. Geosmin typically produces an earthy or musty odor similar to the odor of damp soil and is detectable by many people at concentrations of 5 to 10 parts per trillion (that's five to ten drops in 16 Olympic size pools). Chilling water, adding ice cubes, a slice of lemon or cucumber, or a few drops of lemon juice will improve the taste and odor.

Q. Why am I required to have a backflow device?

A. When customers' private pipes intersect with water system pipelines, a cross-connection is created. Without necessary protections, contamination can result from backflow, or reverse flow, due to changes in water pressure in the distribution system; a backflow device prevents the flow of potentially contaminated water from a customer's pipelines into the water distribution system. In compliance with state law, Vista Irrigation District requires an approved backflow device on commercial, industrial, agricultural and multi-family accounts as well as properties with wells. Backflow protection may also be required on accounts considered "high risk", such as chemical processing, medical and dental facilities, flower growers, and recreational vehicle dump stations.

LEAD AND COPPER

The U.S. Environmental Protection Agency Lead and Copper Rule requires Vista Irrigation District (District) to collect special samples of lead and copper every three years; the last samples were collected in 2024. Lead was not detected at reporting levels in either the source water or private households. Copper was not detected at reporting levels in the source water but was detected in low levels in private households; the source of copper comes from the leaching of copper used in household plumbing fixtures.

If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. The District is responsible for providing high quality drinking water, but cannot control the variety of materials used in plumbing components. If you are concerned about lead in your water, you may wish to have your water tested. If you would like to volunteer for the next round of lead and copper testing, please contact our water quality staff at (760) 597-3143. The ideal lead and copper sampling volunteer would fall into the category of a single family home that has copper plumbing and was built before 1989. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline, 1-800-426-4791, or at <http://www.epa.gov/safewater/lead>.



1391 ENGINEER STREET
VISTA, CA 92081-8840
(760) 597-3100 fax (760) 598-8757
www.vidwater.org

WHERE CAN I GET MORE INFORMATION?

San Diego County Water Authority

(858) 522-6600
www.sdcwa.org

State Water Resources Control Board

Division of Drinking Water and Environmental Management
(619) 525-4159 – Southern California
Drinking Water Field Operations Branch
www.waterboards.ca.gov/drinking_water/programs

U.S. Environmental Protection Agency

Safe Drinking Water Hotline
(800) 426-4791
www.epa.gov/ccr

Metropolitan Water District of Southern California

(213) 217-6000
www.mwdh2o.com

UPDATE YOUR EMERGENCY CONTACT INFORMATION WITH US

Please take a moment and provide us with a telephone number (or telephone numbers) where you can be reached in case of an emergency. Having updated information allows us to contact you quicker during a situation that affects your water supply. You can update your emergency contact number(s) by emailing info@vidwater.org or calling Customer Service at (760) 597-3120. When providing your updated telephone number(s) via email, please include your name and address or account number. Feel free to give us your work, home and cell phone numbers. Thank you for helping us keep you informed.



Vista Irrigation District's board meetings are generally held the first and third Wednesdays of each month at 9:00 a.m. at the District's facilities.